DIQ512 <u>15 MARCH 2007</u>




SmartMod Digital Input/Output Module HE359DIQ512

Four 12/24V DC Inputs (neg. logic) Four Relay Outputs (2A, max)



1 SPECIFICATIONS


		DIQ512			DIQ512	
Inputs per Module (Commons)		4 (1 Common)		Sample Time (PLC Update Rate)	Min. 20mS - Determined by Communications w/OCS	
Input Voltage Range		12/24 VDC		Terminal Type	Screw Type, Removable	
Impedence		4.7k ohms		ronninar rype	ociew rype, Kemovable	
Peak Voltage		30 VDC		Storage Temp.	-40° to 85° Celsius	
ON voltage level		10 VDC		otorage remp.		
OFF voltage level		0-3 VDC	_	Operating Temp.	-10° to 60° Celsius	
Outputs per Module		4 (2 SPDT, 2 SPST)		Relative Humidity	5 to 95% Non-condensing	
Max Switching Power		2A @ 250 VDC 2A @ 30 VDC		Dimensions WxHxD	17.5mm x 100mm x 120mm 0.69" x 3.94" x 4.72"	
Minimum Load		5 VDC, 10mA	_	Weight	210g (8.4 oz.)	
Maximum Voltage		250VAC, 110 VDC		weight	2109 (8.4 02.)	
Required Power (Steady State)	4	5mA @ 24Vdc, typical		Communications	Modbus/RTU (binary) RS-485 half duplex	
Required Power (Inrush)		Negligible		Default Comms. Parameters	38400 baud, N, 8, 1, no h/s Default Modbus ID 1	
Isolation		2000Vac for 60 seconds nput/Power & Input/Comms)		Supported Modbus Commands	1,2,3,4,5,6,8,15,16	
CE & UL Compliance	E & UL Compliance See Compliance Table at http://www.heapg.com/Support/compliance.htm					

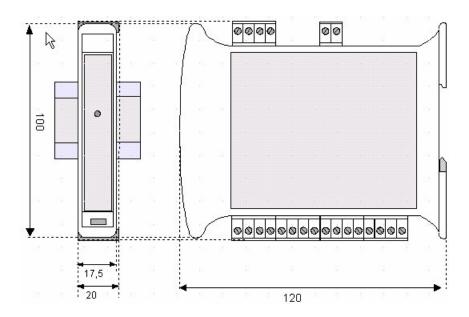


Dimensions in inches are 0.69"W x 3.95"H x 4.72"D Note: Number of I/O terminal connections vary from model to model

DIQ512 15 MARCH 2007

2 WIRING - I/O

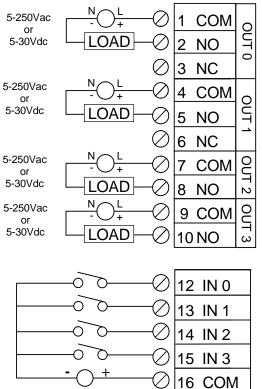







Pin #	DIQ512			
1	COM			
2	N. O.	OUT 0		
3	N. C.			
4	COM			
5	N. O.	OUT 1		
6	N. C.			
7	COM	OUT 2		
8	N.O.	0012		
9	COM	OUT 3		
10	N.O.	0013		

12	INPUT 0	Note:
13	INPUT 1	Each
14	INPUT 2	Output
15	INPUT 3	COM
16	COM	isolated

WIRING - RS-485

WIRING - DC IN





Notes:

Both ends of the RS-485 network should be terminated with a 100ohm, 1/4W, 1% resistor. Many OCS controllers feature dip switches or jumpers which enable appropriate termination if the OCS is located on a network end.

Init Default Setup:

- 1. Install jumper between INIT and GND terminals of the RS-485 port.
- 2. Apply power to Smartmod unit.
- 3. Read parameter words to see current parameters.
- 4. Write changes if necessary.

D-	А	\oslash	
D+	в	\oslash	₩ <u></u>
GND	С	\oslash	
INIT	D	\oslash	•

DIQ512 15 MARCH 2007

The INIT Default RS485 Settings Are:

Modbus ID = 1 Baud rate = 9600Parity = None Stop Bits = 1

3 **CONFIGURATION DATA**

SmartMod Configuration settings are mapped into Modbus Register space. This configuration data may be modified with any Modbus/RTU Master device. For convenience, Horner APG has developed a variety of Cscape application files which allow an OCS (XLe, NX, LX, QX) to act as a SmartMod configurator. Initial configuration of SmartMod module should be done on an individual basis, since all modules come from the factory with a default Modbus ID of 1. Once each module on the network has its own unique Modbus ID, further configuration adjustments can be made with the entire network powered.

All configuration parameters are stored in EPROM. That means they should not be constantly rewritten.

	Configuration Parameters – Registers 40001 through 40013							
Modbus Register	Description	Min	Max	Default				
40001-40005	Reserved							
40006	Communications Parameters	See T	able	38.4kbaud, N, 8, 1, RTU Mode				
40007	Modbus ID	1	255	1				
40008	Rx/Tx Delay (in 2mS steps)	0	255	0mS				
40009	Input Coils							
40010	Output Coils	No	Not Configuration Data – See I/O Data					
40011	Coils							
40012	Power Up/Safe	See Table		0				
40013	Watchdog Timer (in 0.5s steps)	0	255	10 (5s)				

	Register 40006 (Communications Parameters) Bit Definition							
Bits 7-15	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0	
Unused	Mode	Pa	rity	Data Bits	Baud Rate			
	0 = ASCII	Value	Meaning	0 = 7 Data	Value	Meaning		
	0 = ASCII Mode	0	Mark	Bits	0	1200 baud		
	woue	1	Even		1	2400	baud	
	1 = RTU	2	Odd	1 = 8 Data	2	4800	baud	
	Mode	3	Space	Bits	3	9600	baud	
	woue			DIIS	4	19200) baud	
					5-7	38400) baud	

Register 40012 (Power Up / Safe) Bit Definition									
Bits 12-15	Bit 11	Bit 10	Bit 9	Bit 8	Bit 4-7	Bit 3	Bit 2	Bit 1	Bit 0
Unused	Out 3	Out 2	Out 1	Out 0	Unused	Out 3	Out 2	Out 1	Out 0
PowerUp Value						Safe	Value		

INPUT / OUTPUT DATA 4

SmartMod Digital I/O data utilizes both Modbus Registers (40009-40011) and Coils (1-35). It is possible to access all data using Registers only, because the Coils data can be accessed through Registers.

The following tables lists all Modbus I/O data available.

	I/O Register Data (Registers 40009-40011)								
Modbus	–	_	Bits 4-	Bit 3	Bit 2	Bit 1	Bit 0		
Register	Description	Access	15						
40009	Mirror of Input Coil Data	Read-only	unused	In 3	ln 2	In 1	In 0		
40010	Mirror of Output Data	Read/Write	unused	Out 3	Out 2	Out 1	Out 0		
40011	Mirror of Watch Dag Data	Read/Write		aad	PwrUp	W.D.*	W.D.*		
40011	Mirror of WatchDog Data	Reau/White	unu	seu	Event	Event	Enbld		
	*W.D. = Watchdog								

	•	W.D. = Watchdo
Modbus		
Coil	Description	Access
00001	Input 0	Read-only
00002	Input 1	Read-only
00003	Input 2	Read-only
00004	Input 3	Read-only
0005-00016	Reserved	
00017	Output 0	Read/Write
00018	Output 1	Read/Write
00019	Output 2	Read/Write
00020	Output 3	Read/Write
00021-00032	Reserved	
00033	Watchdog Enabled	Read/Write
00034	Watchdog Event	Read/Write
00035	Power-up Event	Read/Write

Watchdog Event & Power-up Event Operation

If Coil 33 (Watchdog Enabled) is set, Coil 34 (Watchdog Event) will set if the Watchdog Timeout value is exceeded. The Watchdog Timeout value is set in Register 40013. When set, Coil 34 can be reset by the controller when normal communications resumes.

The Power-up Event (Coil 35) is set every time the power is applied. It can be cleared by the controller if desired.

5 INSTALLATION / SAFETY

Warning: Remove power from the OCS controller, CAN port, and any peripheral equipment connected to this local system before adding or replacing this or any module.

a. All applicable codes and standards should be followed in the installation of this product.

- b. Shielded, twisted-pair wiring should be used for best performance.
- c. Shields may be terminated at the module terminal strip.
- d. In severe applications, shields should be tied directly to the ground block within the panel.
- e. Use the following wire type or equivalent: Belden 8441.

For detailed installation and a <u>handy checklist</u> that covers panel box layout requirements and minimum clearances, refer to the hardware manual of the controller you are using. (See the **Additional References** section in this document.)

When found on the product, the following symbols specify:



Warning: Consult user documentation.



Warning: Electrical Shock Hazard.

6 TECHNICAL SUPPORT

For assistance and manual up-dates, contact Technical Support at the following locations:

North America: (317) 916-4274 www.heapg.com Europe: (+) 353-21-4321-266 www.horner-apg.com DIQ512 <u>15 MARCH 2007</u>

NOTES